


FINISHED GRADE

TOP OF SUBGRADE

EMBEDMENT AS SPECIFIED

APPROVED PIPE

D1

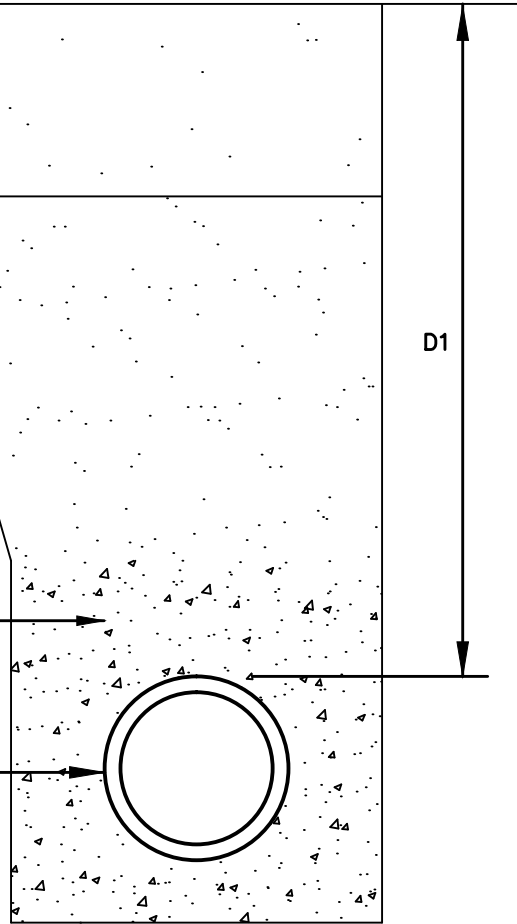

GENERAL NOTES:

1. REFER TO UTILITY DETAIL FOR PAVEMENT REPLACEMENT AND BACKFILL REQUIREMENTS.
2. TRENCH SAFETY SYSTEMS SHALL BE USED WHEN TRENCH DEPTH EXCEEDS 5 FEET.

CONSTRUCTION KEY NOTES:

- A. COVER FOR WATER MAINS SHALL DEPEND ON THE PIPE SIZE AND THE FOLLOWING INSTALLATION CONDITIONS,

CONDITION A – NORMAL LINE INSTALLATION, STREET AND DRAINAGE PROJECTS, WATERLINE RELOCATION

CONDITION B – NEW SUBDIVISIONS, NON-PAVED AREA

AND SHALL BE AS FOLLOWS.

PIPE SIZE	CONDITION	DIMENSION
6", 8"	A	D1 = 4'
6", 8"	B	D1 = 4'
12" & LARGER	A OR B	D1 = 5'

STANDARD
DETAIL

FEB. 1994
REV: 8/3/2006

COVER FOR WATER MAINS

N.T.S.



DETAIL No.

250