


PLAN

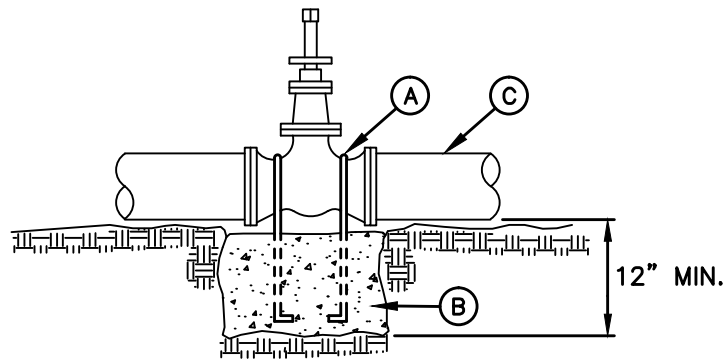

SECTION

GENERAL NOTES:

1. THE ENGINEER SHALL PROVIDE DESIGN FOR ALL VALVES GREATER THAN 12".
2. COMPLY WITH REQUIREMENTS OF AWWA C-550, PROTECTIVE EPOXY INTERIOR COATINGS FOR VALVES.

CONSTRUCTION KEY NOTES:

- A. TWO No. 5 REBAR HAIR PINS. PAINT UNEMBEDDED PORTION OF REBARS WITH TWO COATS OF COAL TAR EPOXY.
- B. CONCRETE VALVE SUPPORT, 2500 PSI. CONCRETE.
- C. APPROVED PIPE.

STANDARD
DETAIL

DATE: 2/1994
REV: 12/12/2011

VALVE ANCHOR

N.T.S.



DETAIL No.
271